


CLINTON WASTEWATER TREATMENT PLANT

Process Flow Diagram

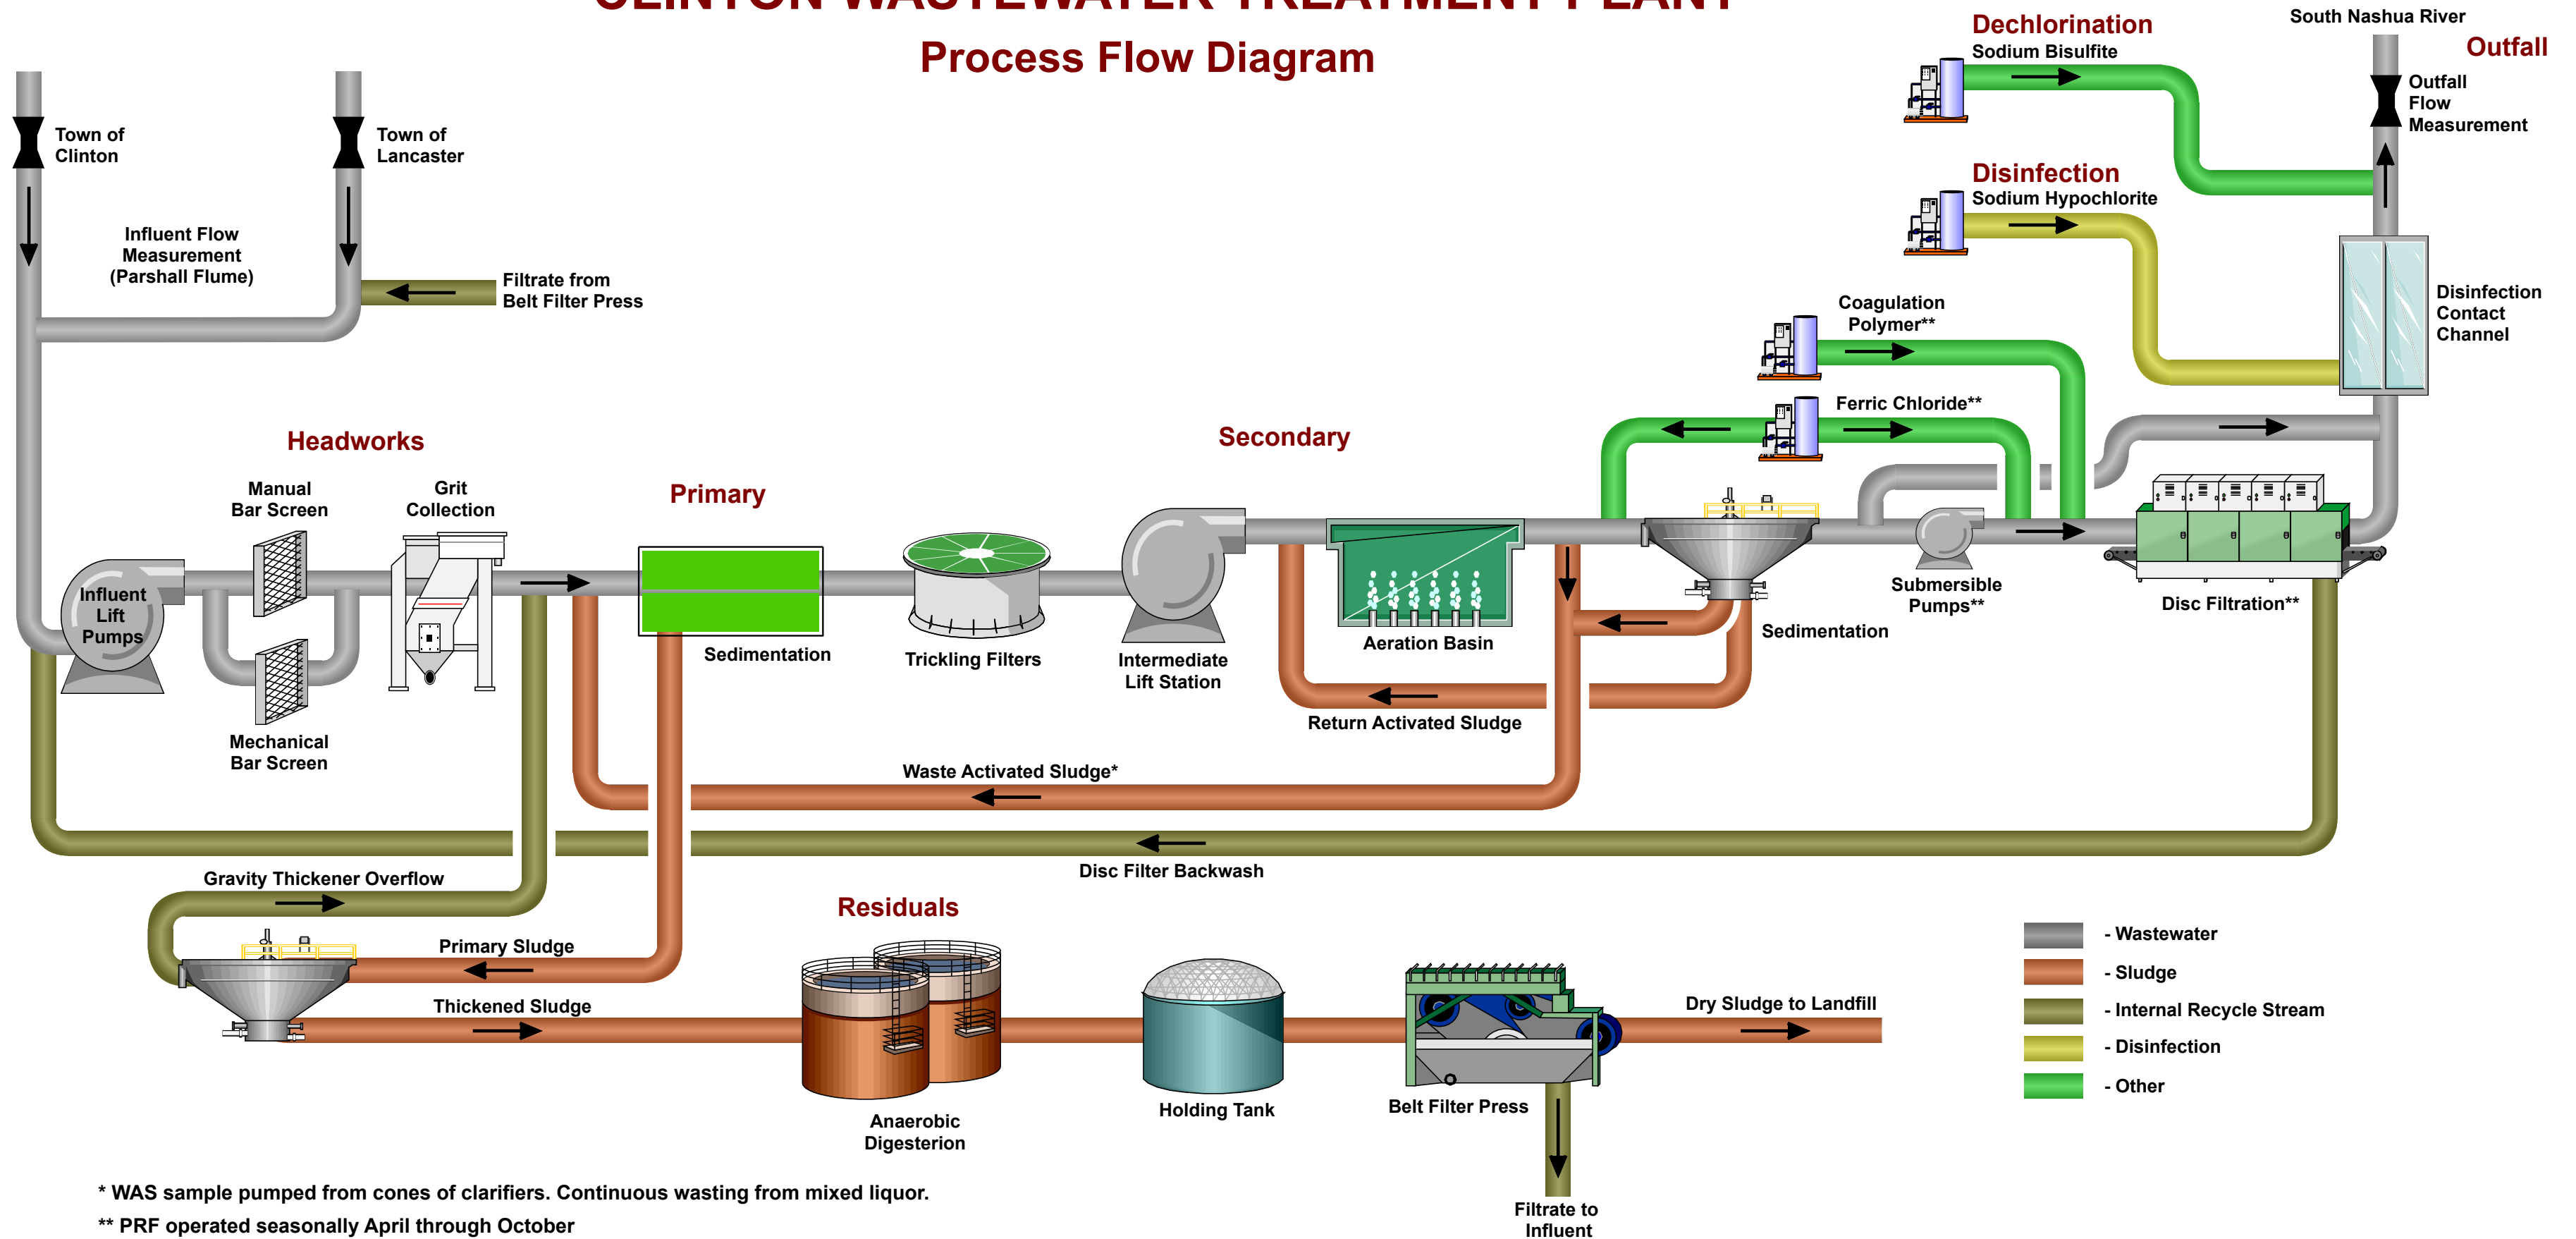

* WAS sample pumped from cones of clarifiers. Continuous wasting from mixed liquor.

** PRF operated seasonally April through October